

親魚水槽および取水井戸水温

仲村伸次・平良正幸*・岸本学*

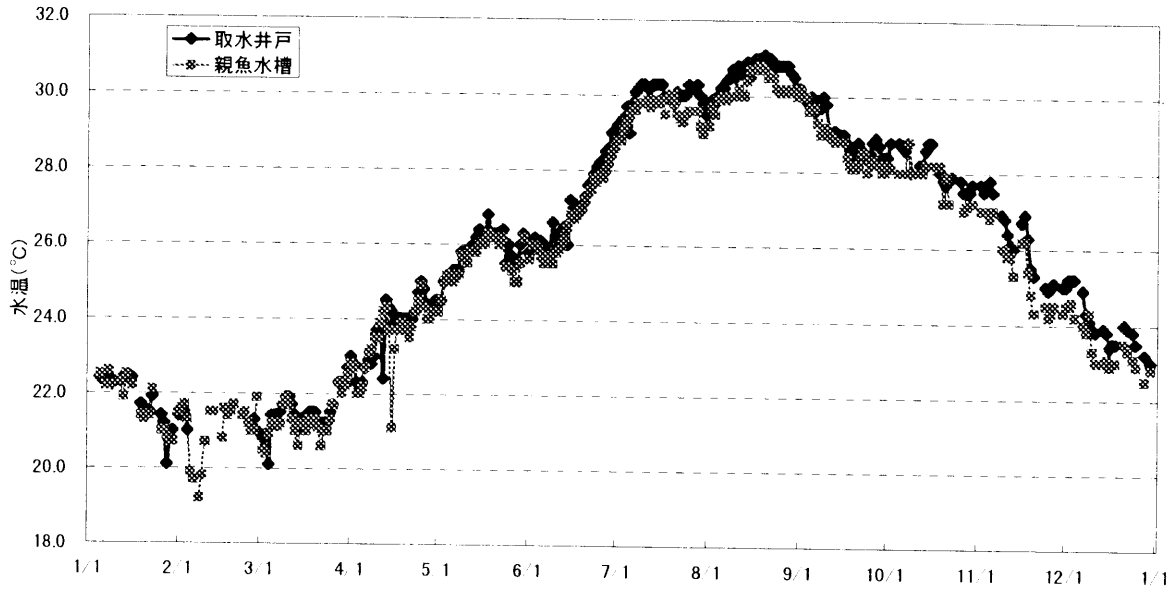


図1 平成10年(1998年)栽培漁業センター親魚水槽および取水井戸水温の推移

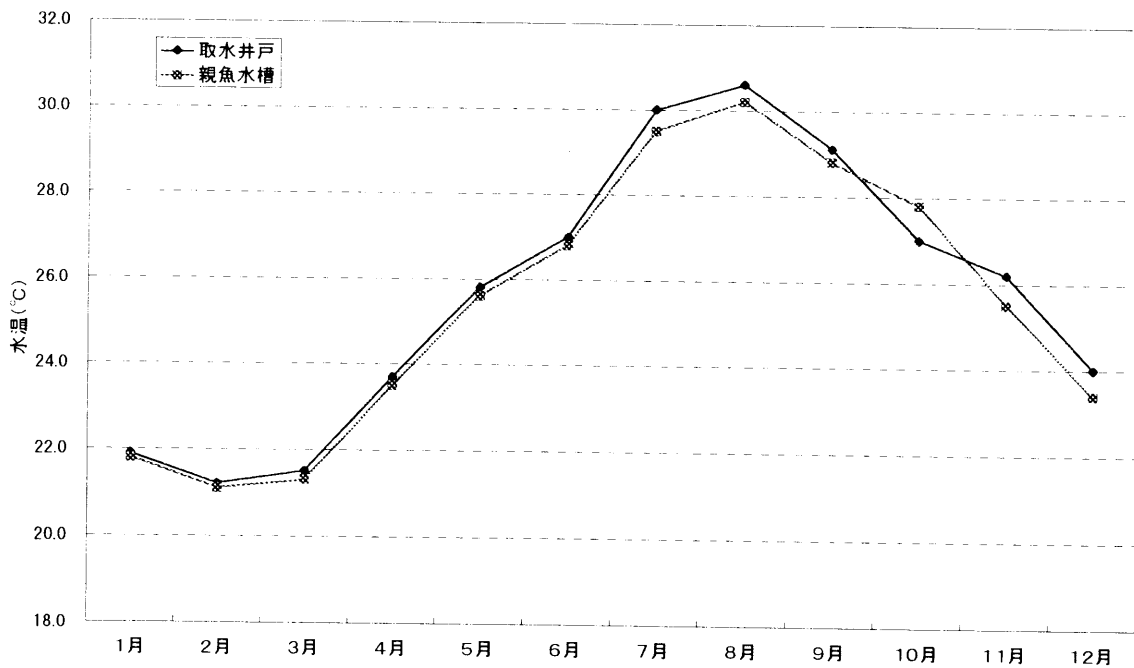


図2 平成10年(1998年)親魚水槽および取水井戸月平均水温の推移

* 非常勤職員

表1 平成10年(1998年)親魚水槽水温

日	月	1	2	3	4	5	6	7	8	9	10	11	12
1	—	—	21.4	—	23.0	24.5	25.8	29.2	29.8	30.2	28.4	—	25.0
2	—	—	21.4	20.8	22.8	24.5	26.1	29.3	29.9	30.0	28.8	27.7	25.2
3	—	—	21.5	20.9	22.3	25.0	26.2	29.4	29.8	29.9	—	27.5	25.2
4	—	—	21.0	20.1	22.1	25.1	26.0	29.7	30.0	29.9	—	27.6	25.2
5	22.4	—	—	21.4	22.3	25.1	26.1	29.0	30.2	30.0	28.8	27.8	—
6	22.3	—	—	21.4	22.7	25.3	26.0	29.8	30.2	29.6	28.7	27.5	—
7	22.3	—	—	21.2	22.9	25.3	25.9	30.1	30.4	29.9	28.6	—	24.9
8	22.4	—	—	21.5	22.8	25.3	25.9	30.2	30.5	29.7	28.8	—	24.3
9	22.2	—	—	21.7	23.0	25.8	26.6	30.3	30.7	30.0	28.0	26.9	24.1
10	—	—	—	21.9	23.7	25.8	26.2	30.3	30.5	29.8	—	26.8	23.9
旬平均	22.3	21.3	21.2	22.8	25.2	26.1	29.7	30.2	29.9	28.6	27.4	24.7	—
11	—	—	—	21.9	23.8	25.8	26.3	30.2	30.8	29.0	—	26.4	23.8
12	22.3	—	—	21.7	22.4	25.9	26.3	30.2	30.6	28.9	28.2	26.1	—
13	22.4	—	—	21.4	24.5	26.0	26.5	30.3	30.7	29.1	28.2	26.0	—
14	22.4	—	—	21.0	24.3	26.2	26.0	30.3	30.9	28.9	28.6	—	23.9
15	—	—	—	21.3	23.8	26.4	27.2	30.3	30.5	29.0	28.8	—	23.8
16	22.4	—	—	21.3	24.1	26.3	27.0	30.3	30.8	29.0	28.8	26.7	23.4
17	—	—	—	21.4	24.0	26.2	27.0	30.0	31.0	28.8	—	26.9	23.5
18	—	—	—	21.5	24.0	26.8	26.9	30.0	31.0	28.6	—	26.3	23.5
19	21.7	—	—	21.5	24.0	26.3	27.1	30.0	31.0	28.3	28.0	25.5	—
20	21.6	—	—	21.5	24.0	26.3	27.3	29.8	31.1	28.6	27.8	25.3	—
旬平均	22.1	—	—	21.5	23.9	26.2	26.8	30.1	30.8	28.8	24.8	26.2	23.7
21	21.5	—	—	21.1	23.9	26.3	27.6	30.1	31.0	28.8	27.7	—	24.0
22	21.5	—	—	21.2	24.0	26.1	27.7	30.0	31.0	28.6	27.8	—	23.9
23	21.9	—	—	21.2	24.2	26.4	27.9	30.0	30.8	28.4	27.9	—	—
24	—	—	—	21.2	24.7	25.5	28.1	30.0	30.8	28.4	—	25.0	23.8
25	—	—	—	21.5	25.0	26.0	28.2	30.3	30.8	28.5	—	24.9	23.5
26	21.4	—	—	21.7	24.8	25.7	28.3	30.2	30.8	28.8	27.8	25.0	—
27	21.2	21.3	—	—	24.4	25.5	28.5	30.2	30.8	28.9	27.5	25.1	—
28	20.1	21.0	22.3	—	24.3	25.5	28.6	30.3	30.8	28.7	27.5	—	23.2
29	20.8	—	—	22.3	24.3	26.0	29.0	30.0	30.6	28.4	27.5	—	—
30	21.0	—	—	22.2	24.5	26.3	28.9	29.8	30.5	28.4	27.7	25.0	23.0
31	—	—	—	22.7	—	—	—	29.5	30.2	—	—	—	—
旬平均	21.2	21.2	21.7	24.4	25.9	28.3	30.0	30.7	28.6	27.7	25.0	23.6	—
月平均	21.9	21.2	21.5	23.7	25.8	27.0	30.0	30.6	29.1	27.0	26.2	24.0	—
年平均	25.7	—	—	—	—	—	—	—	—	—	—	—	—

※ 2月5日～2月26日まで取水井戸工事のため水温測定実施せず

表2 平成10年(1998年)取水井戸地先水温

日	月	1	2	3	4	5	6	7	8	9	10	11	12
1	—	—	21.4	—	23.0	24.5	25.8	29.2	29.8	30.2	28.4	—	25.0
2	—	—	21.4	20.8	22.8	24.5	26.1	29.3	29.9	30.0	28.8	27.7	25.2
3	—	—	21.5	20.9	22.3	25.0	26.2	29.4	29.8	29.9	—	27.5	25.2
4	—	—	21.0	20.1	22.1	25.1	26.0	29.7	30.0	29.9	—	27.6	25.2
5	22.4	—	—	21.4	22.3	25.1	26.1	29.0	30.2	30.0	28.8	27.8	—
6	22.3	—	—	21.4	22.7	25.3	26.0	29.8	30.2	29.6	28.7	27.5	—
7	22.3	—	—	21.2	22.9	25.3	25.9	30.1	30.4	29.9	28.6	—	24.9
8	22.4	—	—	21.5	22.8	25.3	25.9	30.2	30.5	29.7	28.8	—	24.3
9	22.2	—	—	21.7	23.0	25.8	26.6	30.3	30.7	30.0	28.0	26.9	24.1
10	—	—	—	21.9	23.7	25.8	26.2	30.3	30.5	29.8	—	26.8	23.9
旬平均	22.3	21.3	21.2	22.8	25.2	26.1	29.7	30.2	29.9	28.6	27.4	24.7	—
11	—	—	—	21.9	23.8	25.8	26.3	30.2	30.8	29.0	—	26.4	23.8
12	22.3	—	—	21.7	22.4	25.9	26.3	30.2	30.6	28.9	28.2	26.1	—
13	22.4	—	—	21.4	24.5	26.0	26.5	30.3	30.7	29.1	28.2	26.0	—
14	22.4	—	—	21.0	24.3	26.2	26.0	30.3	30.9	28.9	28.6	—	23.9
15	—	—	—	21.3	23.8	26.4	27.2	30.3	30.5	29.0	28.8	—	23.8
16	22.4	—	—	21.3	24.1	26.3	27.0	30.3	30.8	29.0	28.8	26.7	23.4
17	—	—	—	21.4	24.0	26.2	27.0	30.0	31.0	28.8	—	26.9	23.5
18	—	—	—	21.5	24.0	26.8	26.9	30.0	31.0	28.6	—	26.3	23.5
19	21.7	—	—	21.5	24.0	26.3	27.1	30.0	31.0	28.3	28.0	25.5	—
20	21.6	—	—	21.5	24.0	26.3	27.3	29.8	31.1	28.6	27.8	25.3	—
旬平均	22.1	—	—	21.5	23.9	26.2	26.8	30.1	30.8	28.8	24.8	26.2	23.7
21	21.5	—	—	21.1	23.9	26.3	27.6	30.1	31.0	28.8	27.7	—	24.0
22	21.5	—	—	21.2	24.0	26.1	27.7	30.0	31.0	28.6	27.8	—	23.9
23	21.9	—	—	21.2	24.2	26.4	27.9	30.0	30.8	28.4	27.9	—	—
24	—	—	—	21.2	24.7	25.5	28.1	30.0	30.8	28.4	—	25.0	23.8
25	—	—	—	21.5	25.0	26.0	28.2	30.3	30.8	28.5	—	24.9	23.5
26	21.4	—	—	21.7	24.8	25.7	28.3	30.2	30.8	28.8	27.8	25.0	—
27	21.2	21.3	—	—	24.4	25.5	28.5	30.2	30.8	28.9	27.5	25.1	—
28	20.1	21.0	22.3	—	24.3	25.5	28.6	30.3	30.8	28.7	27.5	—	23.2
29	20.8	—	—	22.3	24.3	26.0	29.0	30.0	30.6	28.4	27.5	—	—
30	21.0	—	—	22.2	24.5	26.3	28.9	29.8	30.5	28.4	27.7	25.0	23.0
31	—	—	—	22.7	—	—	—	29.5	30.2	—	—	—	—
旬平均	21.2	21.2	21.7	24.4	25.9	28.3	30.0	30.7	28.6	27.7	25.0	23.6	—
月平均	21.9	21.2	21.5	23.7	25.8	27.0	30.0	30.6	29.1	27.0	26.2	24.0	—
年平均	25.7	—	—	—	—	—	—	—	—	—	—	—	—

※ 2月5日～2月26日まで取水井戸工事のため水温測定実施せず