


付表-1 平成18年度(2006年度)取水井戸(原水)水温  
(2006年4月～2007年3月)

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.2	22.6	25.3	28.2	28.5	29.2	27.6	26.5	24.2	21.9	20.5	21.4	1
2		21.3	23.0	25.6	28.4	28.5		27.7	26.3	23.4	21.9	20.0	21.4	2
3		21.8	22.8	25.5	28.9	28.7		27.7	26.0	23.3	21.9	20.2	21.4	3
4		21.4	23.1	25.4	29.3	28.7		29.2	27.5	26.0	23.1	22.3	20.3	4
5		21.8	22.8	25.5	29.4			29.3	27.3	25.8	23.6	22.3	20.4	5
6		21.8	23.2	25.5	29.4			29.2	27.1	25.8	23.8	22.4	20.8	6
7		21.6	23.5	25.4	29.7	26.8		29.2	26.6	25.6	23.7	21.4	21.0	7
8		21.5	25.2	25.4	29.2	28.4		28.9	26.5	25.5	23.8	21.4	21.1	8
9		21.4	24.6	25.4	28.4	28.5		28.5	26.5	25.4	23.6	21.4	21.3	9
10		21.4	25.6	25.4	27.4	28.2		28.4	26.8	25.5	22.6	21.6	21.4	10
旬平均		21.5	23.6	25.4	28.8	28.3		29.0	27.1	25.8	23.5	21.9	20.7	21.1
11		21.6	25.4	25.3	27.4	28.4		28.3	26.8	25.7	23.0	21.6	21.2	11
12		21.5	26.1	25.2	27.8			28.4	26.8		23.2	21.7	21.4	12
13		21.6	25.9	25.2	27.7			28.4	26.8	24.9	23.3	21.6	21.7	13
14		21.6	25.5	25.2	27.7	28.5		28.5	26.7	25.1	23.6	22.1	21.8	14
15		21.6	24.4	25.4	27.5	28.5		28.4	26.5	24.9	23.2	21.4	21.7	15
16		21.1	24.4	25.5	27.3	28.7		28.6	26.6	24.9	23.2	22.0	21.6	16
17		21.1	25.0	25.8	27.5	28.8			26.4	24.8	22.2	22.4	21.7	17
18		21.0	25.4	26.2	28.0	28.8		28.3	26.4	24.9	22.3	22.2	22.1	18
19		21.3	25.9	26.2	27.9			27.9	26.4	25.1	22.3	21.8	21.9	19
20		21.5	25.3	26.2	27.9			27.9	26.7	25.1	22.1	21.9	21.7	20
旬平均		21.5	25.3	25.6	27.7	28.6		28.3	26.6	25.0	22.8	21.9	21.7	21.0
21		21.4	25.7	26.4	28.1	29.1		27.7	27.1	25.0	22.4	22.0	21.7	21
22		22.8	25.9	26.8	28.3	29.1		27.6	27.2	24.9	22.1	21.8	21.9	22
23		23.6	26.0	27.1	28.3	29.2			27.0	24.8	21.8	21.7	21.7	23
24		23.1	24.9	27.4	28.4	29.2			26.9	25.0	21.6	21.8	21.6	24
25		22.4	25.9	27.8	28.5	29.0		27.4	26.4	25.0	22.1	21.0	21.4	25
26		22.3	25.8	27.8	28.4			27.1	26.5	25.0	22.2	21.1	21.3	26
27		22.5	26.4	28.0	28.4			27.2	26.6	25.1	22.2	21.3	21.4	27
28		22.4	26.1	28.2	28.4	29.1		27.3	26.5	24.9	22.2	20.5	21.4	28
29		22.3	25.5	28.4	28.4	29.0		27.4	26.7	24.6	21.2	19.7	21.5	29
30		22.2	25.4	28.7	28.4	28.9		27.4	26.3	24.4	21.4	20.7	21.6	30
31			25.6		28.6	28.9			26.3		21.6	20.8		31
旬平均		22.5	25.7	27.7	28.4	29.1		27.4	26.7	24.9	21.9	21.1	21.6	21.4
月最高		23.6	26.4	28.7	29.7	29.2		29.3	27.7	26.5	24.2	22.4	22.1	21.8
月最低		21.0	22.6	25.2	27.3	26.8		27.1	26.3	24.4	21.2	19.7	20.0	20.4
月平均		21.8	24.9	26.2	28.3	28.7		28.2	26.8	25.3	22.7	21.6	21.3	21.1

付表-2 平成18年度(2006年度)中間育成場(海面生簀設置海面地先)水温  
(2006年4月～2007年3月)

日	月	4	5	6	7	8	9	10	11	12	1	2	3	日
1		21.3	22.8	25.3	28.4	28.8	29.3	27.6	26.6	23.8	21.8	20.5	21.4	1
2		21.3	23.0	25.6	29.0	28.8		27.9	26.2	22.1	21.7	19.8	21.4	2
3		21.2	22.8	26.0	28.9	28.9		27.7	25.7	22.6	21.9	19.4	21.5	3
4		21.5	23.2	25.6	29.4	28.9		29.4	27.6	26.1	22.6	20.4	21.6	4
5		21.9	23.1	25.7	29.6			29.4	27.3	25.8	23.5	22.2	20.5	5
6		21.9	23.3	25.5	29.9			29.6	26.7	26.2	23.7	21.6	19.9	6
7		21.6	23.7	25.5	29.8	28.3		28.2	25.4	26.1	23.6	20.9	21.0	7
8		21.5	25.6	25.5	28.8	28.5			26.2	25.6	23.3	21.3	21.0	8
9		21.5	24.8	25.5	28.1	28.9		28.8	26.6	25.6	23.5	21.2	21.3	9
10		21.4	26.0	25.5	27.8	28.5		28.8	26.9	25.6	22.5	20.8	21.4	10
旬平均		21.5	23.8	25.6	29.0	28.7		29.1	27.0	26.0	23.1	21.6	20.5	20.8
11		21.6	26.4	25.4	27.9	28.7		28.6	26.9	25.8	23.1	21.2	20.3	11
12		21.6	26.2	25.2	28.0			28.6	26.9	24.6	23.3	21.5	21.5	12
13		22.3	26.2	26.1	27.8			28.6	26.7	24.8	23.3	21.4	21.6	13
14		21.7	26.2	25.2	27.8	28.8		28.7	26.6	25.3	23.6	21.0	21.6	14
15		21.7	24.5	25.4	27.2	28.9		28.7	26.5	25.3	23.2	21.3	20.4	15
16		21.1	24.6	25.6	27.8	29.0		28.8	26.5	25.0	23.1	21.9	21.6	16
17		20.6	25.2	26.1	27.3	29.1			26.8	24.7	21.5	22.3	21.6	17
18		21.0	25.7	26.4	28.2	29.3		28.0	26.3	24.0	21.6	22.1	21.8	18
19		21.4	26.2	26.3	28.2			28.2	26.8	25.2	21.5	21.3	21.3	19
20		21.5	25.0	26.6	28.3			28.1	26.9	25.0	21.8	21.6	21.6	20
旬平均		21.5	25.6	25.8	27.9	29.0		28.5	26.7	25.0	22.6	21.6	21.3	20.7
21		21.5	25.8	26.8	28.3	29.4		28.0	27.3	25.2	22.4	21.6	21.7	21
22		23.3	26.0	27.1	27.8	29.4		28.0	27.2	25.0	21.4	21.3	21.9	22
23		23.7	26.1	27.4	28.0	29.3			27.3	24.7	20.6	21.6	21.6	23
24		23.2	25.9	27.6	28.6	29.3			26.8	25.0	21.0	21.3	19.6	24
25		22.5	26.0	28.2	28.7	29.3		27.1	26.4	24.8	22.0	20.4	21.4	25
26		22.4	26.0	28.2	28.6			27.3	26.6	25.1	22.3	21.1	21.3	26
27		22.4	26.6	28.3	28.7			27.3	26.5	25.2	22.3	21.1	21.3	27
28		22.4	26.2	28.5	28.9	29.3		27.4	26.6	24.8	21.8	21.0	21.5	28
29		22.0	25.6	28.8	28.7	29.3		27.6	26.0	24.6	19.6	18.3	21.5	29
30		22.5	25.4	28.9	28.6	29.3		27.6	26.1	24.3	20.8	20.2	21.7	30
31			25.5		28.9	29.3			26.4		21.3	20.5		31
旬平均		22.6	25.9	28.0	28.5	29.3		27.5	26.7	24.9	21.4	20.8	21.3	21.4
月最高		23.7	26.6	28.9	29.9	29.4		29.6	27.9	26.6	23.8	22.3	21.9	21.8
月最低		20.6	22.8	25.2	27.2	28.3		27.1	25.4	24.0	19.6	18.3	19.4	19.4
月平均		21.9	25.1	26.5	28.5	29.0		28.3	26.8	25.3	22.3	21.3	21.0	21.0

付図 - 1 取水井戸及び地先の月平均水温の推移

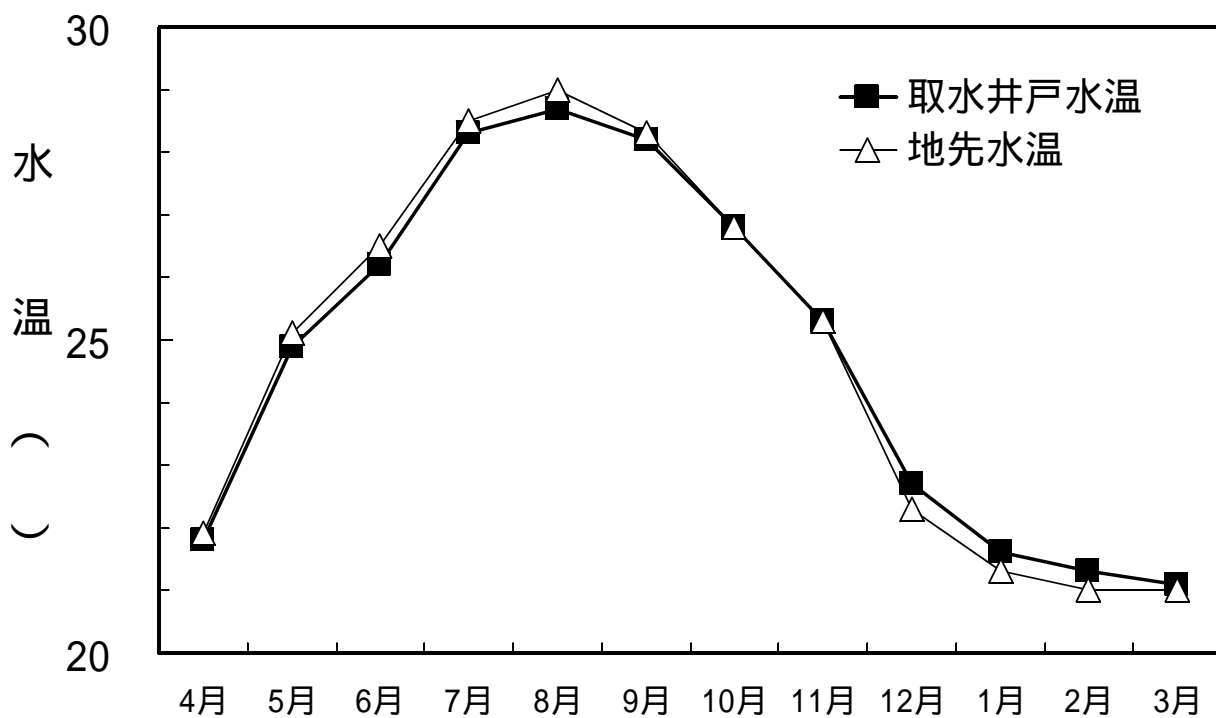

付図 - 2 取水井戸及び地先の日水温の推移

